

715 XS VALVE WITH SA/ SA-X 05 ELECTRIC ACTUATOR

FEATURES

The stainless steel 715XS+SA05 2-way ball valve is dedicated to the automatic shut-off of uncharged industrial fluids. This full-bore ball valve has an antistatic device and is certified according to the EC and ATEX standards (with SA-X). The ISO 5211 pad enables the direct mounting of the SA05 electric actuator. It is perfectly adapted for an indoor or outdoor industrial use.


AVAILABLE MODELS

1.4408 stainless steel (A351 CF8M) body.

Diameters 1/2" to 2".


BSP threaded connections.

Supply voltages : 12Vdc, 24Vac/dc, 230Vac.



LIMITS OF USE

Fluid pressure : PS	63 bar (20°C)
Fluid temperature : WT°	- 10°C / +180°C
Ambiant temperature	- 20°C / + 70°C
Service factor	<u>S2</u> : 15mn – <u>S4</u> : 50%

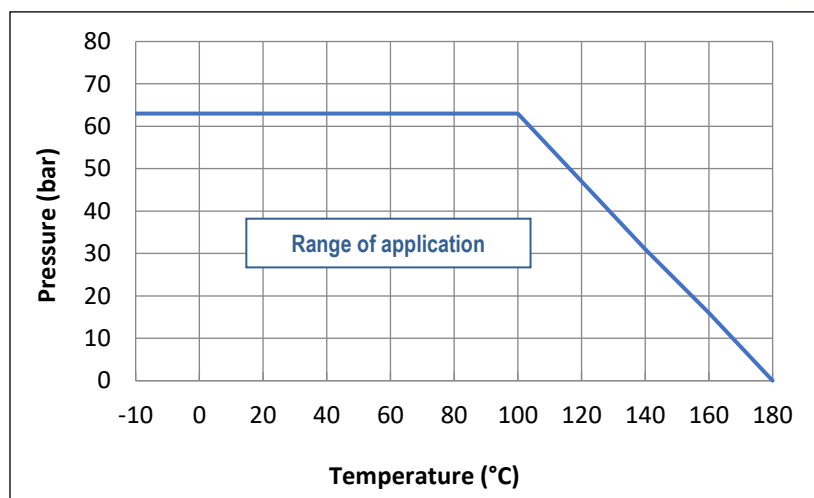

DIRECTIVES AND MANUFACTURING STANDARD

OBJET	Standard	ON	OBJET	Standard
Pressure Equipment Directive 2014/68/EC	<u>1/2" and 3/4"</u> : not subject		Final test	EN 12266
	<u>1" to 2"</u> : category	TÜV 0035	Material certificate	EN 10204
Size	EN 12516-1		Motorisation connection	ISO 5211
Steel grade	EN 1503-1			
ATEX Directive	Valve	SIRA 0518	II 2G/D Tx for areas 1,2,21 and 22	
	actuator (option SA-X)	KEMA 0344	II 2G EEx d II B T4 for areas 1 and 2	

Information given as an indication only, and subject to possible modifications




SECTORIEL S.A.
45 rue du Ruisseau
38290 SAINT QUENTIN-FALLAVIER – FRANCE
Tél : +33 4 74 94 90 70 - Fax : +33 4 74 94 13 95
www.sectoriel.com / courrier : sectoriel@sectoriel.fr

Pages	1/6
Ref.	TDS715XS+SA05 ENG
Rev.	03
Date	11/2023

715 XS VALVE WITH SA/ SA-X 05 ELECTRIC ACTUATOR

CONSTRUCTION

No.	Name	Material	No.	Name	Material
1	Body	SS A351 CF8M /1.4408	11	Lever	304 SS
2	End cap	SS A351 CF8M /1.4408	12	Nut	304 SS
4	Seat	PTFE+15% GF	13	End top	304 SS
5	Stem	316 SS	14	Sleeve	PVC
6	Body gasket	PTFE	15	O-ring	FKM
7	Washer	PTFE	16	Sliding block	304 SS
8	Gland packing	PTFE	17	Antistatic device	316 SS
9	Washer	304 SS	18	Spring	316 SS
10	Belleville spring washer	301 SS			

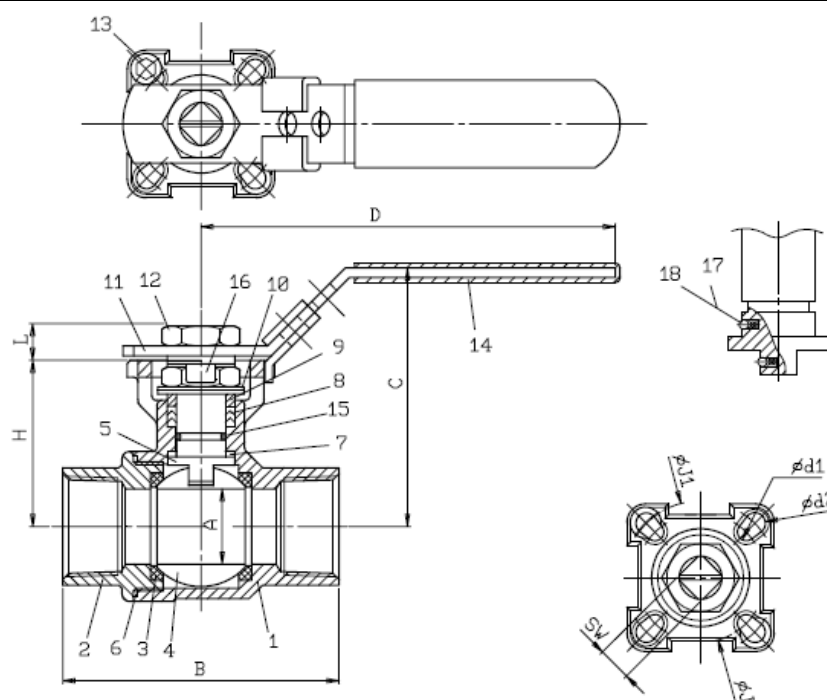

DIMENSIONS (mm)

DN	A	B	C	D	H	L	J	J1	d1	d2	SW
1/2"	15	55	70,9	110	42,3	8	42	50	6	7	9
3/4"	20	76	73,4	110	44,9	8	42	50	6	7	9
1"	24,5	83	84,1	135	54	10	42	50	6	7	11
1"1/4	32	91	89,3	165	59,2	10	50	70	7	9	11
1"1/2	38	103	109,5	165	71,3	10	50	70	7	9	11
2"	50	120	118,9	165	82,9	14,8	50	70	7	9	14
2"1/2	65	155	155	300	107	17.1	70	102	9	11	17
3"	80	182	165	335	117	17.1	70	102	9	11	17

Information given as an indication only, and subject to possible modifications



SECTORIEL S.A.
45 rue du Ruisseau
38290 SAINT QUENTIN-FALLAVIER – FRANCE
Tél : +33 4 74 94 90 70 - Fax : +33 4 74 94 13 95
www.sectoriel.com / courrier : sectoriel@sectoriel.fr

Pages	2/6
Ref.	TDS715XS+SA05 ENG
Rev.	03
Date	11/2023

715 XS VALVE WITH SA/ SA-X 05 ELECTRIC ACTUATOR

SA 05 ELECTRICAL MOTORISATION

Suggested standard SA actuation under the following conditions :

- Electric actuator with an IP 67 epoxy coated aluminium enclosure and steel gears,
- A minimum 1.3 safety factor compared with the valve nominal torque rating,
- A maximum pressure differential up/downstream of 10 bar ($=\Delta P$),

Direct mounting of the electric actuator.

DN	Actuator	Power	Intensity 230V AC	Intensity 24V AC-DC	Time*	Standard equipment of the electric actuator
1/2"	SA 05	6 W	28 mA	1,8 mA	17 s	2 adjustable limit switches. 2 dry auxiliary switches. 5 W anti-condensation heater. Actuator thermal cut-out Manual override by key. Backlit position indicator (except for SA-X). Electrical connection: 2 gland packs M20x1,5
3/4"	SA 05	6 W	28 mA	1,8 mA	17 s	
1"	SA 05	6 W	28 mA	1,8 mA	17 s	
1"1/4	SA 05	6 W	28 mA	1,8 mA	17 s	
1"1/2	SA 05	6 W	28 mA	1,8 mA	17 s	
2"	SA 05	6 W	28 mA	1,8 mA	17 s	

For any other operating conditions, please contact us.

* indicative time for actuator running empty

MOTORISATION OPTIONS

There are many options for which you are invited to contact our sales service:

1	2	3	4	5
SA 05 S : Slow closing electric actuator 100 s	SA 05 PCU : Regulation actuator 4-20 mA or 0-10 V	SA 05 SCP : Safety actuator with an integrated battery emergency shutdown	SA 05 X : Actuator for use in ATEX zones 1 and 2	SR 05 : Safety spring return actuator
				
6	SAPUI electric actuator with feedback potentiometer			
7	Thermal dispersion bracket for high temperature fluids			
8	100 mm stem extension for pipe insulation (see 500HC model)			
9	Electric actuator sized for a maximum pressure differential up/downstream over 10 bar ($=\Delta P$)			
10	NA electric actuator with a declutchable manual override by handwheel			

ATEX ZONES INSTALLATION

It is compulsory to specify if the installation of the automatic valve 715XS+SA-X will take place in ATEX zones 1 or 2 while making the order. Our services will proceed to the mounting check, to a grounding strip installation and will edit a mounting certificate. Those operations are performed by our proper engineers. Please contact us for further details. It is also compulsory to follow the ATEX zone mounting and maintenance special instructions for motorized valves. The ATEX gland packs and sealing plugs are not provided. Please use the following codes:

ATEX aluminium gland pack M20x1.5	Code 980179	ATEX aluminium sealing plugs M20x	Code 980180
-----------------------------------	-------------	-----------------------------------	-------------

Information given as an indication only, and subject to possible modifications

	SECTORIEL S.A. 45 rue du Ruisseau 38290 SAINT QUENTIN-FALLAVIER – FRANCE Tél : +33 4 74 94 90 70 - Fax : +33 4 74 94 13 95 www.sectoriel.com / courrier : sectoriel@sectoriel.fr	Pages	3/6
		Ref.	TDS715XS+SA05 ENG
		Rev.	03
		Date	11/2023

715 XS VALVE WITH SA/ SA-X 05 ELECTRIC ACTUATOR

ASSEMBLY AND MAINTAINANCE INSTRUCTIONS

1 - Installation

1.1 - Checks

- Check that the material of the valve body is chemically compatible with the fluid.
- Check that the pressure and service conditions are compatible with the (P, T) diagram of the valve. See § "Service limits"
- Check that the fluid is clean and free of particles. The latter could scratch the ball and damage the seats, hence causing the valve to leak. If need be, install an upstream filter.
- Check that there is no risk of thermal expansion of the fluid, which could damage the seats. In the open position, a hole at the top of the ball balances the pressures between the body cavity and the flow of the fluid. As an option, we recommend a relief hole upstream of the valve for balancing the pressures for fluids such as ammonia, LPG, chlorine, etc.
- Check that the valve is not used for flow or pressure control since it is not intended for this use and there is a risk of premature wear of the seats, in particular in the event of high pressure and/or temperature. For this special application, preferably use our "V-port" 746XS version with a V-shaped hole in the ball. Please contact us.
- Check that the valve is not used on a gas which might condense at certain times during the process. In such a case, the pressure within the body cavity could become negative, which could lead to a significant deformation of the seats. Please contact us.
- Static electricity: the valve will be supplied with a ball-stem-body internal electrical continuity tester. If the service conditions require the electrical continuity of the installation, check its earthing.
- If the valve is installed in an explosive zone, you must follow the additional "IMEVMATEX" instructions.

1.2 - Storage before installation

- Follow our general "IMESTOCK" instructions for storage.


1.3 - Installation

- Before any installation, isolate the piping upstream and downstream, depressurize the piping and bring the installation to ambient temperature. Carefully clean the piping of any particle (foreign body, dust, rust, etc.) or shavings by water rinsing or air blowing.
- For valves with a size above DN50, plan to use a hoist.
- Remove the protective tips from the valve ends.
- Check the cleanliness of the internal surfaces of the valve and if need be, clean them.
- Direction of mounting: the valves do not have a preferred direction of mounting, unless a relief hole was drilled into the ball.
- Check the perfect alignment and the proper support of the pipe installation upstream and downstream of the valve. Alignment defects cause mechanical deformations which can block the valve or lead to leaks at the body gaskets.
- Check that the standards for the valve internal thread and pipe thread are the same.
- Cover the pipe threads using a sealing material (tow, PTFE tape, sealing glue, etc.) which is suitable for the fluid.
- Screw the tube into the valve end clockwise, as shown in the diagram below.
- Check the sealing of the connection using a suitable test (hydrostatic test or leak detection spray).
- Hydraulic test of the installation:
 - Valves were tested at the factory at 1.5 x WP.
 - If a hydrostatic test is carried out on the installation, do not exceed the authorised pressure.

Information given as an indication only, and subject to possible modifications

	SECTORIEL S.A. 45 rue du Ruisseau 38290 SAINT QUENTIN-FALLAVIER – FRANCE Tél : +33 4 74 94 90 70 - Fax : +33 4 74 94 13 95 www.sectoriel.com / courrier : sectoriel@sectoriel.fr	Pages	4/6
		Ref.	TDS715XS+SA05 ENG
		Rev.	03
		Date	11/2023

715 XS VALVE WITH SA/ SA-X 05 ELECTRIC ACTUATOR

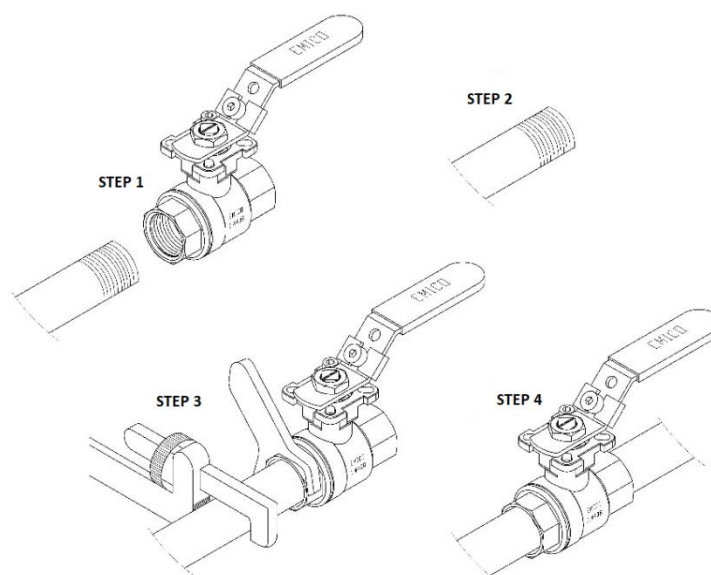


2 - Service

- If a hot fluid flows across the valve, do not touch the valve surface.
- Always operate the valve slowly and smoothly.
- Opening clockwise, closing anti-clockwise.

3 - Servicing

3.1 - Frequency of servicing

- The servicing frequency depends upon the use of the valve, of the type of fluid, of its velocity, of its frequency of operation, of the cycles of rise and fall in pressure and temperature.
- Before any intervention, isolate the upstream and downstream pipe installation using the valves provided for this purpose. Depressurize the pipe installation and bring it to ambient temperature.
- If the lever has to be removed, do that before disassembling the body.
- To remove the central body, unscrew the lateral end (item 2).
- To remove the ball from the body, turn the stem by a quarter turn.

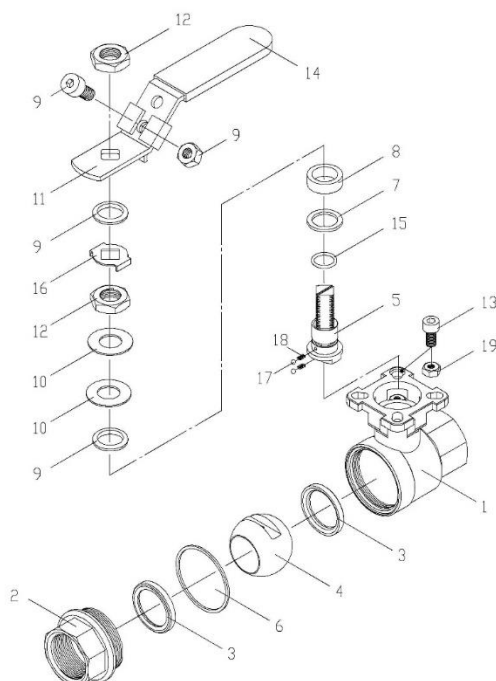

Information given as an indication only, and subject to possible modifications

	SECTORIEL S.A. 45 rue du Ruisseau 38290 SAINT QUENTIN-FALLAVIER – FRANCE Tél : +33 4 74 94 90 70 - Fax : +33 4 74 94 13 95 www.sectoriel.com / courrier : sectoriel@sectoriel.fr	Pages	5/6
		Ref.	TDS715XS+SA05 ENG
		Rev.	03
		Date	11/2023

715 XS VALVE WITH SA/ SA-X 05 ELECTRIC ACTUATOR

3.2 – Inspecting the state of the valve and possible repair

- Check the state of the ball (Item 4): it has to be clean and unscratched. If the cleaning or polishing is not possible, replace it (see the § on spare parts).
- Check the state of the seats (3.1 and 3.2): they must not be deformed, nor scratched, nor worn, or dirty. Otherwise, replace them with parts from the gasket kit.
- Check the state of the packing gland (7.8 and 9): no leak should be found at the stem and the rings should not be excessively worn. If need be, replace the gaskets.
- Check the state of the body gasket (6.1 and 6.2). Replace it, if need be.
- Reassemble the different parts of the valve, following the tightening torques shown in the table below.
- Check that the stem manoeuvring is smooth. Perform about ten manoeuvres.

TABLE OF THE TIGHTENING TORQUES OF THE TIE-BOLTS AND OF THE LEVER NUT

DN	Lever nut (Nm)
1/4" – 6	4
3/8" – 10	4
1/2" - 15	4
3/4" - 20	4
1" - 25	4.5
1"1/4 - 32	4.5
1"1/2 - 40	5.5
2" - 50	5.5
2"1/2 - 65	7
3" - 80	7
4 " - 100	7

SPARE PARTS


DN	Gasket kit	Ball	Lever
Reference mark	6-7-8-15	4	11
1/2" - 15	Please contact us.	980032	982802
3/4" - 20	Please contact us.	980033	982802
1" - 25	Please contact us.	980034	982804
1"1/4 - 32	Please contact us.	980035	982804
1"1/2 - 40	Please contact us.	980036	982806
2" - 50	Please contact us.	980037	982806
2"1/2 - 65	Please contact us.	Please contact us.	982808
3" - 80	Please contact us.	Please contact us.	982808
4 " - 100	Please contact us.	Please contact us.	982808

Information given as an indication only, and subject to possible modifications



SECTORIEL S.A.
45 rue du Ruisseau
38290 SAINT QUENTIN-FALLAVIER – FRANCE
Tél : +33 4 74 94 90 70 - Fax : +33 4 74 94 13 95
www.sectoriel.com / courrier : sectoriel@sectoriel.fr

Pages	6/6
Ref.	TDS715XS+SA05 ENG
Rev.	03
Date	11/2023

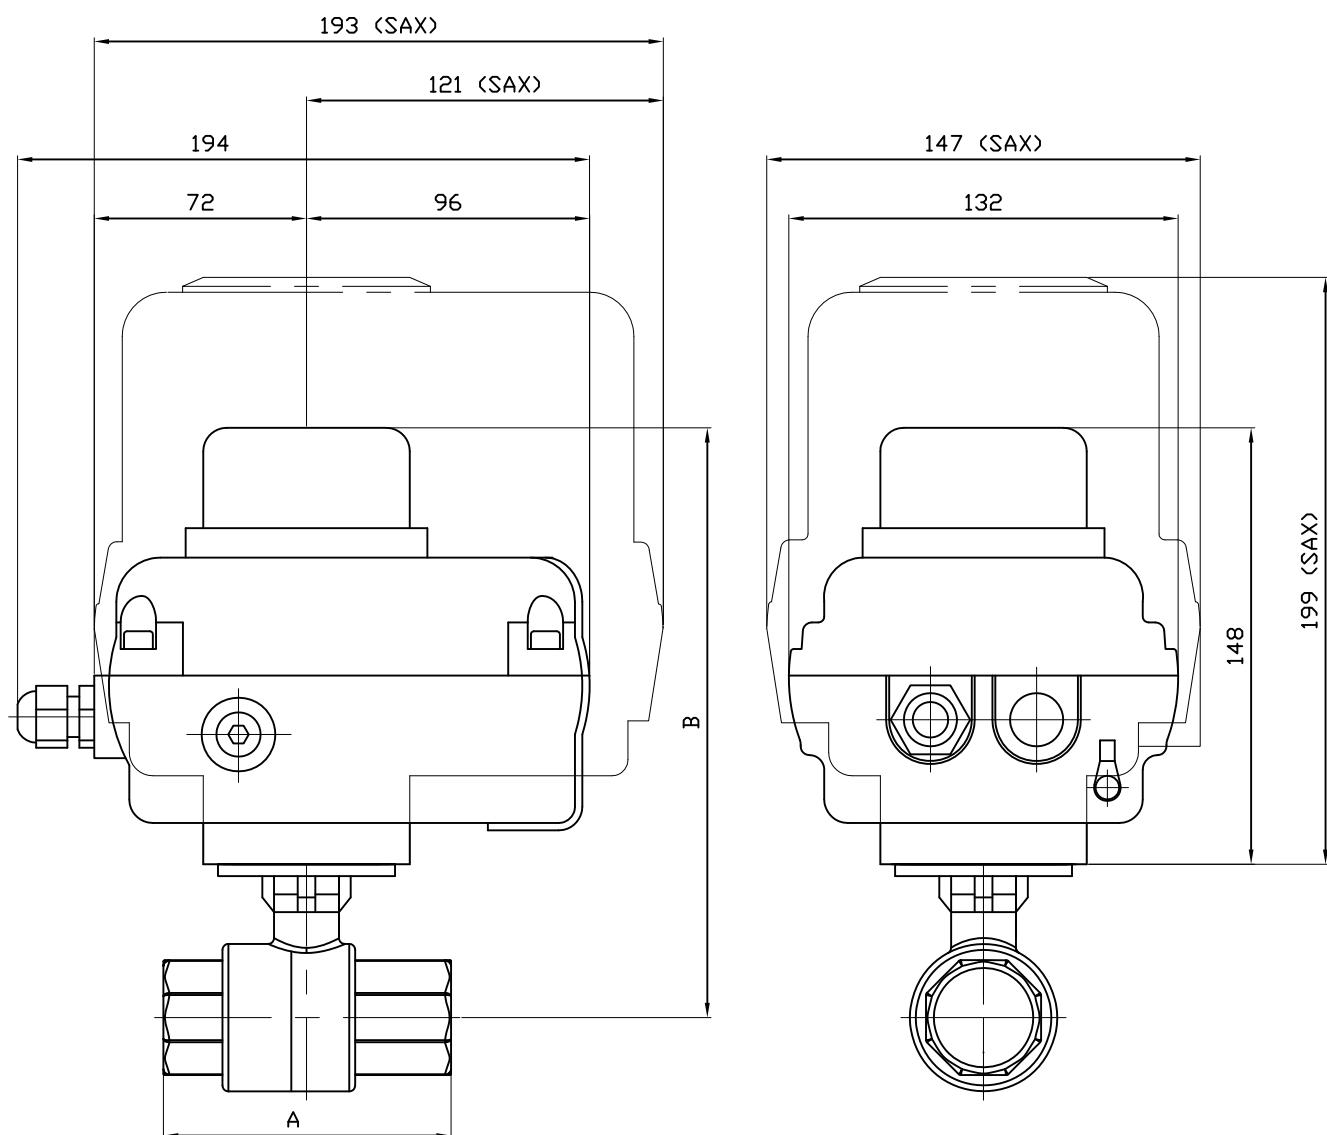

DN	1/2"	3/4"	1"	1 1/4"	1 1/2"	2"
A	57	71	83	91	104	123
B	190.3	193	202	207	219.3	231
B(SAX)	241.3	244	253	258	270.3	282
KG	3.27	3.44	3.87	4.35	5.32	6.94
KG(SAX)	5.47	5.64	6.07	6.55	7.52	9.14

Informations données à titre indicatif et sous réserve de modifications éventuelles
data subject to alteration

				Ajout SA05X et poids	22/02/2012	A
Ech: /	Date :27/09/2006	Dessiné par : L.L	Tolérances générales : +/- 0.2	Modifications	Date	REV.
ROBINET A TOURNANT SPHERIQUE 715XS/BALL VALVE 715XS + SERVOMOTEUR SA05-SA05X / ELECTRIC ACTUATOR SA05-SA05X				Matière :		
				Poids (Kg) :		
				Traitement : SANS		
 45, Rue du Ruisseau 38297 SAINT QUENTIN FALLAVIER				Plan n° Ens 964A		

SA 05 ELECTRIC ACTUATOR

FEATURES

The SA 05 electric actuator is intended for motorising industrial 1/4" turn valves. The torque is of 50 Nm. With a compact, robust construction and IP67 epoxy-coated aluminium housing, the SA actuator is especially well suited for motorising ball valves and butterfly valves installed in workshops or outdoors. The SA 05 has a manual key control and a 3D visual position indicator. Compliant with the EN 15714-2 standard.

AVAILABLE MODELS

Supply voltages: 230 Vac (50-60Hz), 24 Vac/dc and 12 Vdc.

Options: 110 Vac, feedback potentiometer, local command.



LIMITS OF USE

IP Code	IP 67
Ambient temperature	- 20°C / +70°C
Service factor	S2 : 15mn - S4 : 50%

MECHANICAL FEATURES

Gear box	treated steel pinions
Torque	50 Nm
Angle of rotation	90° +/- 5°
Declutching	Without
Override control	by key (except for SA 05 S)



Actuator	SA 05			SA 05 S	
Voltage	230V AC	24V AC/DC	12V DC	230V AC	24V AC/DC
Torque (Nm)	50				
Manoeuvring time (s)	17	10	11	100	100
ISO 5211	F03/F05/F07 star 14				

ELECTRICAL FEATURES

Motor protection	Thermal switch	Anti-condensation	5W heater
Limit switches	2 adjustable switches	Electrical connection	2 x P.E. M20x1.5
Auxiliary switches	2 adjustable dry switches		

Actuator	SA 05			SA 05 S	
Voltage	230V AC	24V AC/DC	12V DC	230V AC	24V AC/DC
Power (W)	6 W	15 W	6 W	6 W	6 W
Current (A)	0.23	1.8	3.2	0.23	1.8

Information given as an indication only, and subject to possible modifications




SECTORIEL S.A.
45 rue du Ruisseau
38290 SAINT QUENTIN-FALLAVIER - FRANCE
Telephone: +33 4 74 94 90 70 - Fax: +33 4 74 94 13 95
www.sectoriel.com / Email: sectoriel@sectoriel.fr

Pages	1/3
Ref.	FT23010 ENG
Rev.	14
Date	05/2023

SA 05 ELECTRIC ACTUATOR





CONSTRUCTION

1	Housing	Polyester-coated aluminium
2	Electrical motor	
3	Gear box	Treated steel pinions
4	Cover	Polyester-coated aluminium
5	Position indicator	Polycarbonate plastic
6	Condenser	
7	Handle override	
8	Earthing	
9	Cable inlet	
10	Anti-condensation heater	
11	Terminal box	

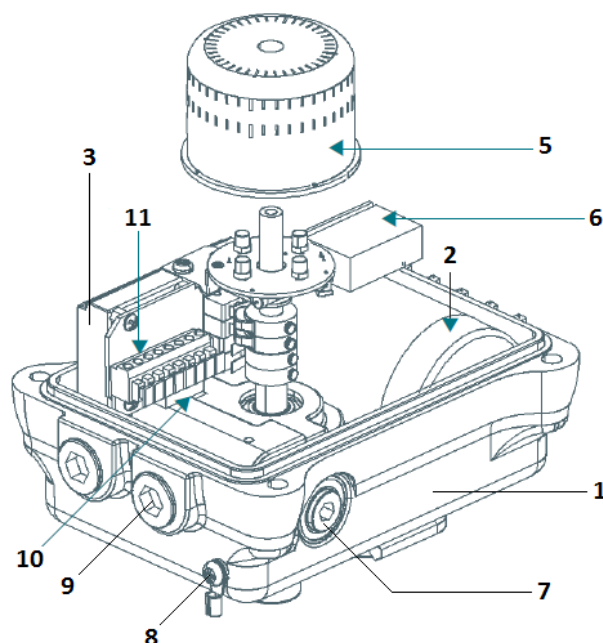

DIMENSIONS (mm) AND WEIGHT (kg)

Dimensions (mm)	A	B	C	D	E	Weight (kg)
SA 05	127	170	70	153	80	3.2

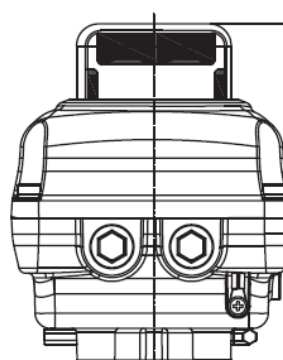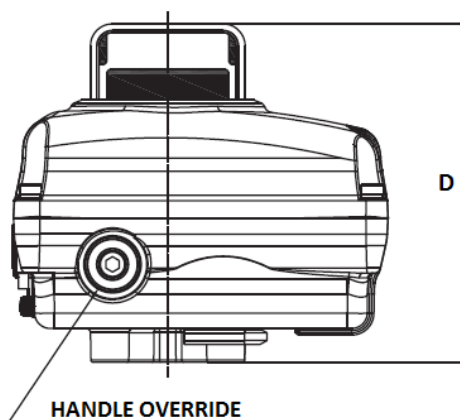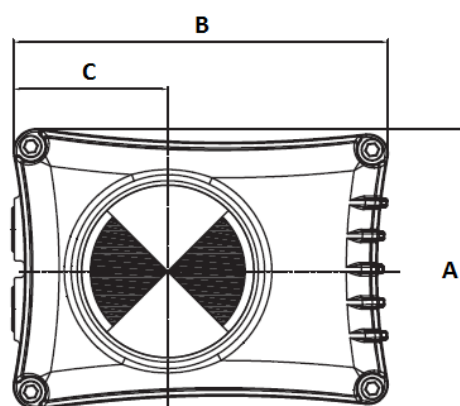

Information given as an indication only, and subject to possible modifications

	SECTORIEL S.A. 45 rue du Ruisseau 38290 SAINT QUENTIN-FALLAVIER - FRANCE Telephone: +33 4 74 94 90 70 - Fax: +33 4 74 94 13 95 www.sectoriel.com / Email: sectoriel@sectoriel.fr	Pages	2/3
		Ref.	FT23010 ENG
		Rev.	14
		Date	05/2023

SA 05 ELECTRIC ACTUATOR

WIRING DIAGRAM 230V AC 50Hz/60Hz

1	common	CLS : Close Limit Switch (250VAC 3A) OLS : Open Limit Switch (250VAC 3A) ACLS : Aux Close Limit Switch (250VAC 3A) AOLS : Aux Open Limit Switch (250VAC 3A) TP : Thermal Protector (250VAC 3A) RM : Motor Regulation
2	Anti-condensation heater	
3	closing command	
4	opening command	
5	closing auxiliary	
6	closing auxiliary	
7	opening auxiliary	
8	Opening auxiliary	

WIRING DIAGRAM 24V AC/DC-12V DC

1	Common or +	CLS : Close Limit Switch (250VAC 3A) OLS : Open Limit Switch (250VAC 3A) ACLS : Aux Close Limit Switch (250VAC 3A) AOLS : Aux Open Limit Switch (250VAC 3A) TP : Thermal Protector (250VAC 3A) RM : Motor Regulation
2	Closing command	
3	Opening command	
4	closing auxiliary	
5	opening auxiliary	
6	Auxiliaries common	
7	Anti-condensation heater power supply	
8	Anti-condensation heater power supply	

OPTIONS

1	SA 05 X: version for ATEX zone
2	SA 05 PIU: version with feedback potentiometer
3	SA 05 CPT: version with position transmitter 4-20 mA
4	SA 05 PCU: version with adjustment card 0-10, 2-10V, 2-20 mA, 4-20 mA
5	SA 05 LCU: version with local control
6	SA 05 RBP: version with in-built fail safe/security

Information given as an indication only, and subject to possible modifications



SECTORIEL S.A.
 45 rue du Ruisseau
 38290 SAINT QUENTIN-FALLAVIER - FRANCE
 Telephone: +33 4 74 94 90 70 - Fax: +33 4 74 94 13 95
www.sectoriel.com / Email: sectoriel@sectoriel.fr

Pages	3/3
Ref.	FT23010 ENG
Rev.	14
Date	05/2023

SA 05-X ELECTRIC ACTUATOR

FEATURES

SA05-X electric actuators are intended for motorising 1/4" turn valves in explosive zones. The torque is of 50 Nm. The protection mode is a "d" explosion-proof. With a compact, robust construction and IP67 epoxy-coated aluminium housing, the SA05-X actuator is especially well suited for motorising ball valves and butterfly valves installed in difficult atmospheres. The SA05-X has a manual key control and a 3D visual position indicator. Compliant with the EN 15714-2 standard.

AVAILABLE MODELS

Supply voltages: 230V AC (50-60Hz), 24V AC/DC.

LIMITS OF USE

IP Code	IP 67
Ambient temperature	- 20°C / +55°C
Service factor	S2: 15mn - S4: 50%



ATEX APPROVAL

Protection mode	"d" according to the EN 60079-1 standard
Category of material	2
Operation zones	1G and 2G
Marking	II 2 G Ex d IIB T4 (ON KEMA no. 0344)



MECHANICAL FEATURES

Gear box	treated steel pinions
Torque	50 Nm
Angle of rotation	90° +/- 5°
Declutching	Without
Override control	By key

Actuator	SA 05-X (50Hz)		SA 05-X (60Hz)
Voltage	230V AC	24V AC/DC	230V AC
Torque (Nm)	50		50
Manoeuvring time (s)	17	10	14
ISO 5211	F03/F05/F07 star 14		

Information given as an indication only, and subject to possible modifications

	SECTORIEL S.A. 45 rue du Ruisseau 38290 SAINT QUENTIN-FALLAVIER - FRANCE Telephone: +33 4 74 94 90 70 - Fax: +33 4 74 94 13 95 www.sectoriel.com / Email : sectoriel@sectoriel.fr	Pages	1/4
		Ref.	FT23310 ENG
		Rev.	08
		Date	10/2023

SA 05-X ELECTRIC ACTUATOR


ELECTRICAL FEATURES

Motor protection	Thermal switch	Anti-condensation	5W heater
Limit switches	2 adjustable switches	Electrical connection	2 x C.G. M20x1.5 ATEX (NOT SUPPLIED on option)
Auxiliary switches	2 adjustable dry switches		

Actuator	SA 05 X	
Voltage	230V AC	24V AC/DC
Power (W)	6 W	6 W
Current (A)	0.23	1.8

CONSTRUCTION

1	Housing	Polyester-coated aluminium
2	Electrical motor	
3	Gear box	Treated steel pinions
4	Cover	Polyester-coated aluminium
5	Position indicator	Polycarbonate plastic
6	Condenser	
7	Handle override	
8	Earthing	
9	Cable inlet	
10	Anti-condensation heater	
11	Terminal box	
12	Indicator light	Toughened glass

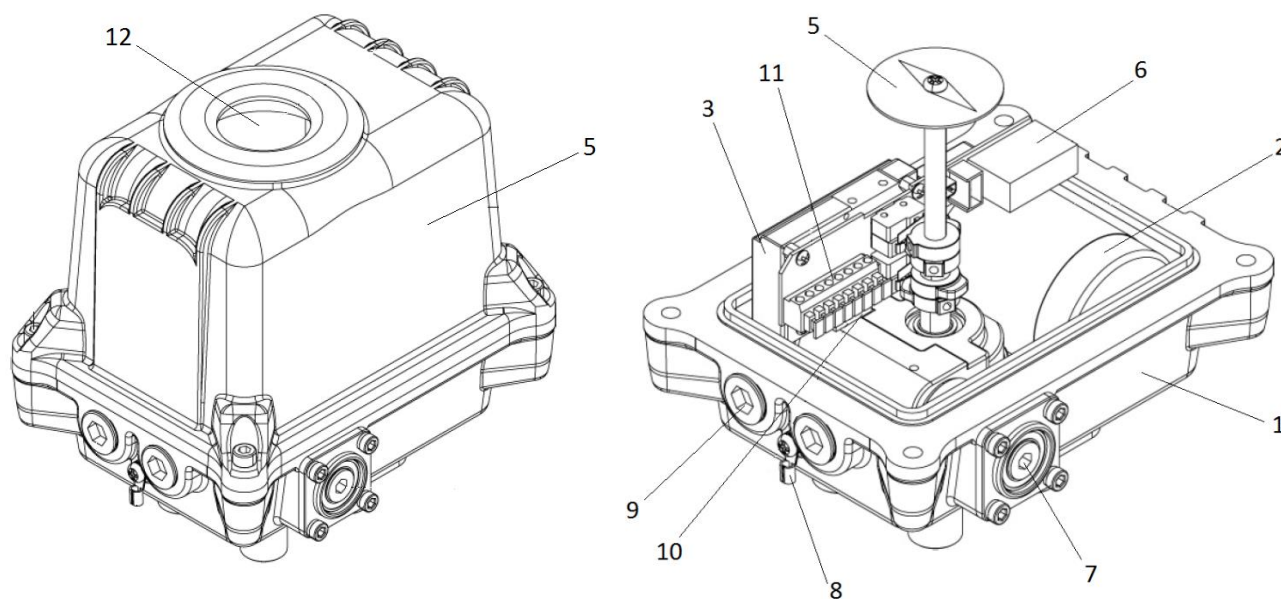


Information given as an indication only, and subject to possible modifications

	SECTORIEL S.A. 45 rue du Ruisseau 38290 SAINT QUENTIN-FALLAVIER - FRANCE Telephone: +33 4 74 94 90 70 - Fax: +33 4 74 94 13 95 www.sectoriel.com / Email : sectoriel@sectoriel.fr	Pages	2/4
		Ref.	FT23310 ENG
		Rev.	08
		Date	10/2023

SA 05-X ELECTRIC ACTUATOR

DIMENSIONS (mm) AND WEIGHT (kg)

Dimensions (mm)	A	B	C	D	E	F	Weight (kg)
SA05-X	147	73	193	83	100	199	5

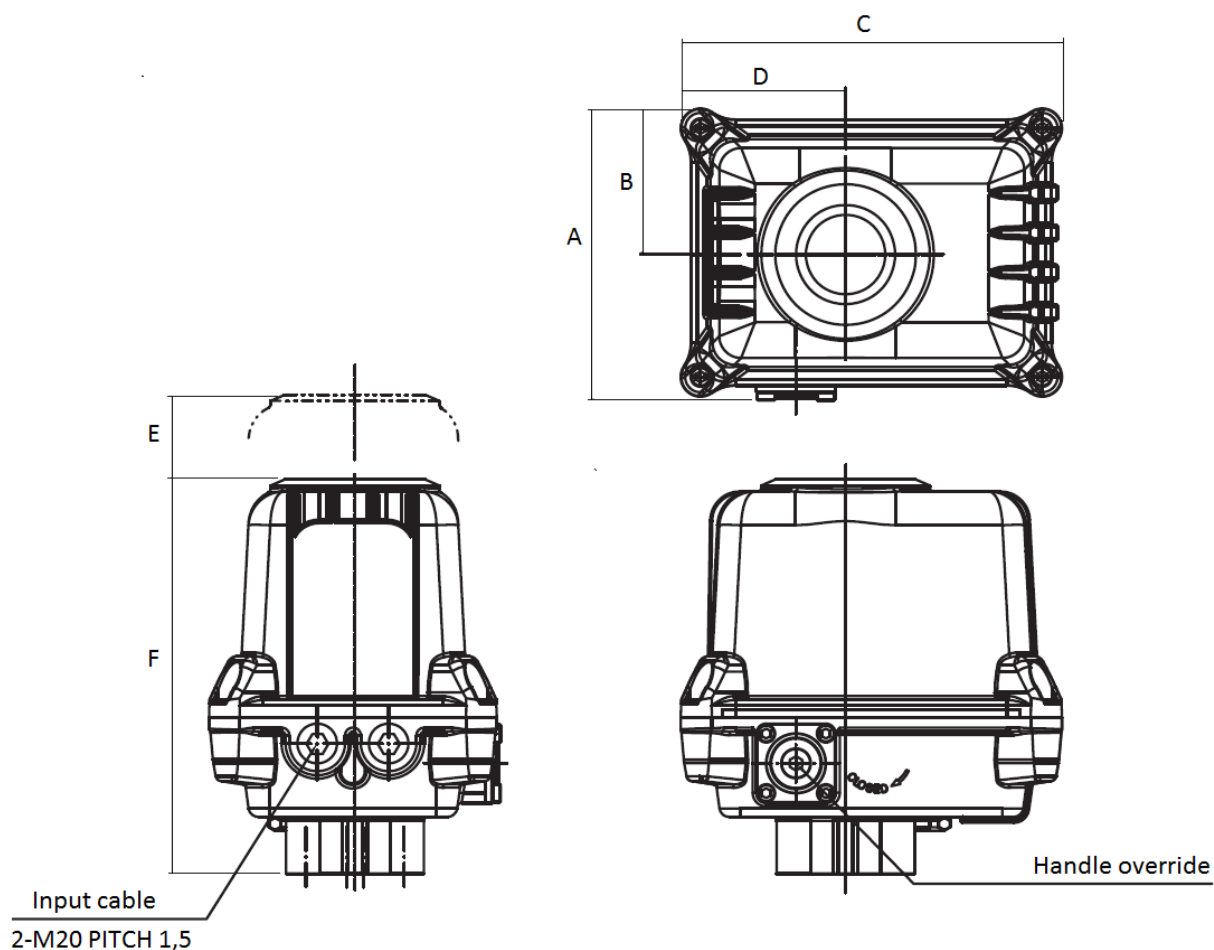

Information given as an indication only, and subject to possible modifications

	SECTORIEL S.A. 45 rue du Ruisseau 38290 SAINT QUENTIN-FALLAVIER - FRANCE Telephone: +33 4 74 94 90 70 - Fax: +33 4 74 94 13 95 www.sectoriel.com / Email : sectoriel@sectoriel.fr	Pages	3/4
		Ref.	FT23310 ENG
		Rev.	08
		Date	10/2023

SA 05-X ELECTRIC ACTUATOR

WIRING DIAGRAM 230V AC 50Hz/60Hz

1	common	CLS : Close Limit Switch (250VAC 3A) OLS : Open Limit Switch (250VAC 3A) ACLS : Aux Close Limit Switch (250VAC 3A) AOLS : Aux Open Limit Switch (250VAC 3A) TP : Thermal Protector (250VAC 3A) RM : Motor Regulation
2	Anti-condensation heater	
3	closing command	
4	opening command	
5	closing auxiliary	
6	closing auxiliary	
7	opening auxiliary	
8	Opening auxiliary	

WIRING DIAGRAM 24V AC/DC

1	Common or +	CLS : Close Limit Switch (250VAC 3A) OLS : Open Limit Switch (250VAC 3A) ACLS : Aux Close Limit Switch (250VAC 3A) AOLS : Aux Open Limit Switch (250VAC 3A) TP : Thermal Protector (250VAC 3A) RM : Motor Regulation
2	Closing command	
3	Opening command	
4	closing auxiliary	
5	opening auxiliary	
6	Auxiliaries common	
7	Anti-condensation heater power supply	
8	Anti-condensation heater power supply	

Information given as an indication only, and subject to possible modifications

	SECTORIEL S.A. 45 rue du Ruisseau 38290 SAINT QUENTIN-FALLAVIER - FRANCE Telephone: +33 4 74 94 90 70 - Fax: +33 4 74 94 13 95 www.sectoriel.com / Email : sectoriel@sectoriel.fr	Pages	4/4
		Ref.	FT23310 ENG
		Rev.	08
		Date	10/2023